

Features

- NEMA 1, 3, 4, 4X, 6, 6P, 9, 13, IP66, 67
- Water tight, dust tight, and corrosion resistant for outdoor use
- For use in hazardous locations:
 - Class I, Div. 1 & 2, Groups C, D
 - Class II, Div. 1 & 2, Groups E, F, G
- UL listed explosion proof switch enclosure:
 - UL Listed, File #E14274.
 - CSA Certified , File #LR57324
 - ATEX/IEC EX Approved File # KEMA 01ATEX2111 X
- Adjustable length trip rod
- Ample wiring space
- Knurled Mounting Bracket prevents slipping
- RoHS Compliant

NOTICE

Before any work is done on the fire sprinkler or fire alarm system, the building owner or their authorized representative shall be notified. Before opening any closed valve, ensure that opening the valve will not cause any damage from water flow due to open or missing sprinklers, piping, etc.



Important: This document contains important information on the installation and operation of valve supervisory switches. Please read all instructions carefully before beginning installation. A copy of this document is required by NFPA 72 to be maintained on site.

Description

The OSYSU-EX-O is designed to supervise the position of an Outside Screw & Yoke type gate valve in hazardous outdoor locations. The device mounts on the valve to monitor the rising stem. When properly mounted, the trip rod will be resting in a groove filed into the valve stem. When the valve stem begins to move, caused by closing the valve, the trip rod will be pushed out of the groove and activate the switch. To aid with installation the trip rod length is adjustable. This device features a UL listed explosion proof switch enclosure.

Testing

The operation of the OSYSU-EX-O and its associated protective monitoring system shall be inspected, tested, and maintained in accordance with all applicable local and national codes and standards and/or the Authority Having Jurisdiction (manufacturer recommends quarterly or more frequently). A minimum test shall consist of turning the valve wheel towards the closed position. The OSYSU-EX-O shall operate within the first two revolutions of the wheel. Fully close the valve and ensure that the OSYSU-EX-O does not restore. Fully open the valve and ensure that the OSYSU-EX-O restores to normal only when the valve is fully opened.

CAUTION

Close the valve fully to determine that the stem threads do not activate the switch. The switch being activated by the stem threads could result in a **false valve open** indication.


Technical Specifications

Dimensions	See Fig. 3
Weight	3.83 lbs (1,73 kg)
Materials	Switch Enclosure - Aluminum Bracket/Mounting Bar - 316 Stainless Steel Hardware - Stainless Steel
Contact Ratings	One set of SPDT 15 Amps at 125VAC .5 Amps at 125VDC Terminals accept up to 14AWG wire
Environmental Limitations	-13°F to 185°F (-25°C to 85°C) Class I, Div. 1 & 2, Groups C, D Class II, Div. 1 & 2, Groups E, F, G NEMA 1, 3, 4, 4X, 6, 6P, 9, 13, IP66 and 67 For indoor applications use model OSYSU-EX
Conduit Entrances	Two 3/4"-14 NPT threaded entrances
Service Use	NFPA 13, 13D, 13R, 72

Specifications subject to change without notice

Small Valve Installation - 1/2" (12,5mm) Through 2 1/2" (63,5mm)

Fig 1

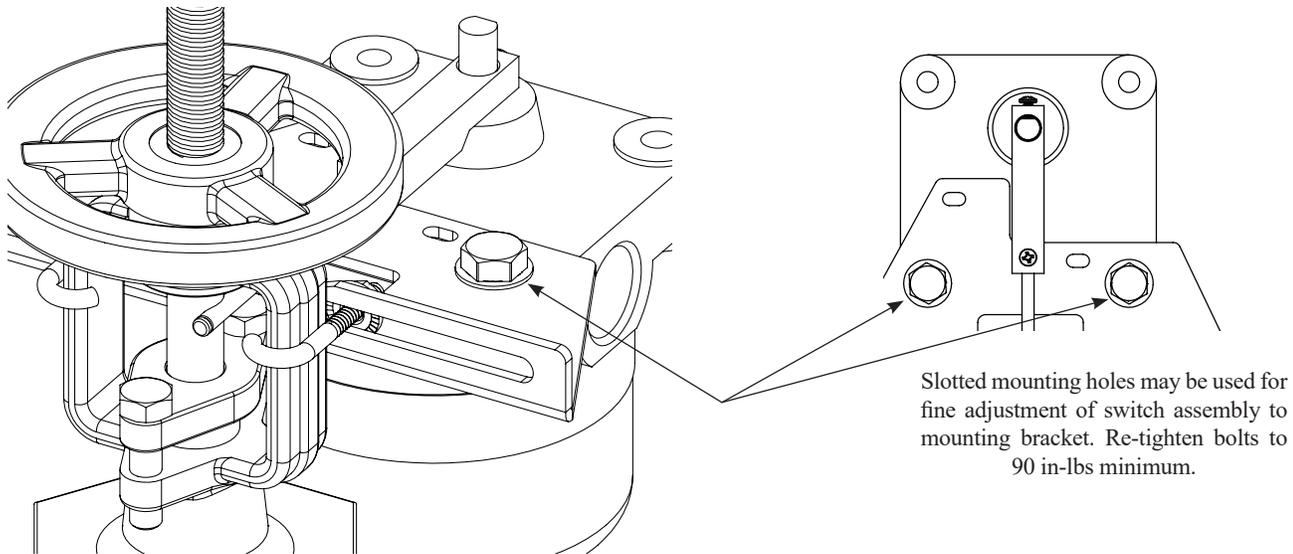

Small Valve Installation

NOTE: If the valve stem is pre-grooved at 1/8" minimum depth; proceed to step 7.

1. Remove and discard "E" ring and roller from the trip rod.
2. With the valve in the FULL OPEN position, locate the OSYSU-EX-O across the valve yoke as far from the valve gland so that the spring loaded trip rod of the OSYSU-EX-O is pulled against the non threaded portion of the valve stem. Position the OSYSU-EX-O with the bracket near the handwheel as shown in Fig. 1 if possible to avoid creating a pinch point between the wheel and the OSYSU-EX-O.

3. Loosen the locking screw that holds the trip rod in place and adjust the rod length (see Fig. 3). When adjusted properly, the rod should extend past the valve screw, but not so far that it contacts the clamp bar. Tighten the locking screw to 5 in-lbs minimum to hold the trip rod in place.

NOTE: If trip rod length is excessive, loosen the locking screw and remove the trip rod from the trip lever. Using pliers, break off the one (1) inch long notched section (see Fig. 4). Reinstall trip rod and repeat Step 3 procedure.

4. Mount the OSYSU-EX-O loosely with the carriage bolts and clamp bar supplied. On valves with limited clearance use J-hooks supplied instead of the carriage bolts and clamp bar to mount the OSYSU-EX-O.
5. Mark the valve stem at the center of the trip rod.
6. Remove the OSYSU-EX-O. Utilizing a 3/16" or 1/4" diameter straight file, file a 1/8" minimum depth groove centered on the mark on the valve stem. Deburr and smooth the edges of the

groove to prevent damage to the valve packing and to allow the trip rod to move easily in and out of the groove as the valve is operated.

NOTE: A groove depth of up to approximately 3/16" can make it easier to install the OSYSU-EX-O so that it does not restore as it rolls over by the threads of the valve stem.


7. Mount the OSYSU-EX-O on the valve yoke with the spring loaded trip rod of the OSYSU-EX-O pulled against the valve stem and centered in the groove of the stem. If possible, position the OSYSU-EX-O, as shown in Fig. 1, to help avoid creating a pinch point between the wheel and OSYSU-EX-O.
8. Final adjustment can be made by slightly loosening the two bolts on the bracket and using the fine adjustment feature (see Fig. 1). The adjustment is correct when the switches are not activated with the trip rod seated in the valve stem groove and that the switches activate when the trip rod moves out of the groove (there is continuity between the COM and NO terminals on the switches).
9. Tighten the adjustment bolts and all mounting hardware securely (90 in-lbs minimum). Check to insure that the rod moves out of the groove easily and that the switches activate within two turns when the valve is operated from the FULL OPEN towards the CLOSED position.
10. Reinstall the cover and tighten ensuring the cover is fully installed and o-ring is present.

CAUTION

Close the valve fully to determine that the stem threads do not activate the switch. The switch being activated by the stem threads could result in a *false valve open* indication.

Large Valve Installation - 3" Through 12" Sizes

Fig 2

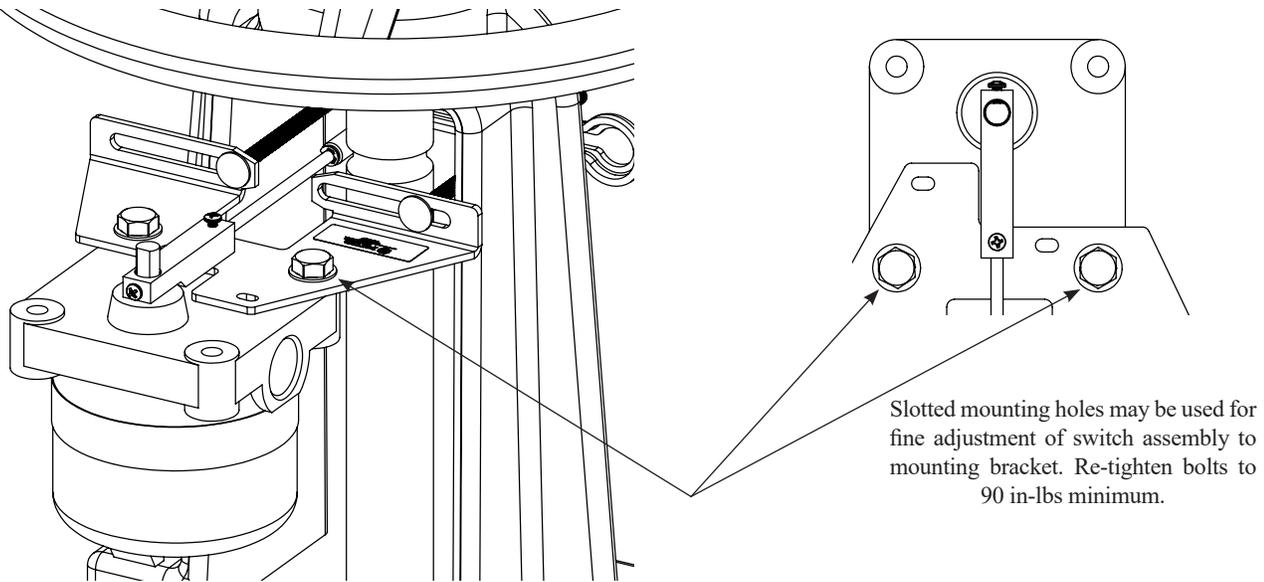

Large Valve Installation

NOTE: If the valve stem is pre-grooved at 1/8" minimum depth; proceed to step 6.

1. With the valve in the FULL OPEN position, locate the OSYSU-EX-O across the valve yoke as far from the valve gland so that the spring loaded trip rod of the OSYSU-EX-O is pulled against the non threaded portion of the valve stem. Position the OSYSU-EX-O with the bracket near the handwheel as shown in Fig. 2 if possible to avoid creating a pinch point between the wheel and the OSYSU-EX-O.
 2. Mount the OSYSU-EX-O loosely with the carriage bolts and clamp bar supplied.
 3. Loosen the locking screw that holds the trip rod in place and adjust the rod length (see Fig. 3). When adjusted properly, the rod should extend past the valve screw, but not so far that it contacts the clamp bar. Tighten the locking screw to 5 in-lbs minimum to hold the trip rod in place.
- NOTE:** If trip rod length is excessive, loosen the locking screw and remove the trip rod from the trip lever. Using pliers, break off the one (1) inch long notched section (see Fig. 4). Reinstall trip rod and repeat Step 3 procedure.
4. Mark the valve stem at the center of the trip rod.
 5. Remove the OSYSU-EX-O. Utilizing a 3/8" or 1/2" diameter straight file, file a 1/8" minimum depth groove centered on the mark on the valve stem. Deburr and smooth the edges of the groove to prevent damage to the valve packing and to allow the trip rod to move easily in and out of the groove as

the valve is operated.



NOTE: A groove depth of up to approximately 3/16" can make it easier to install the OSYSU-EX-O so that it does not restore as it rolls over by the threads of the valve stem.

6. Mount the OSYSU-EX-O on the valve yoke with the spring loaded trip rod of the OSYSU-EX-O pulled against the valve stem and centered in the groove of the stem. If possible, position the OSYSU-EX-O as shown in Fig. 2, to help avoid creating a pinch point between the wheel and OSYSU-EX-O.
7. Final adjustment can be made by slightly loosening the two bolts on the bracket and using the fine adjustment feature (see Fig. 2). The adjustment is correct when the switches are not activated with the trip rod seated in the valve stem groove and that the switches activate when the trip rod moves out of the groove (continuity between COM and NO terminals on the switches).
8. Tighten the adjustment bolts and mounting hardware securely (minimum 90 in-lbs). Check to insure that the rod moves out of the groove easily and that the switches activate within two turns when the valve is operated from the FULL OPEN towards the CLOSED position.
9. Reinstall the cover and tighten ensuring the cover is fully installed and o-ring is present.

CAUTION
Close the valve fully to determine that the stem threads do not activate the switch. The switch being activated by the stem threads could result in a <i>false valve open</i> indication.


Dimensions

Fig 3

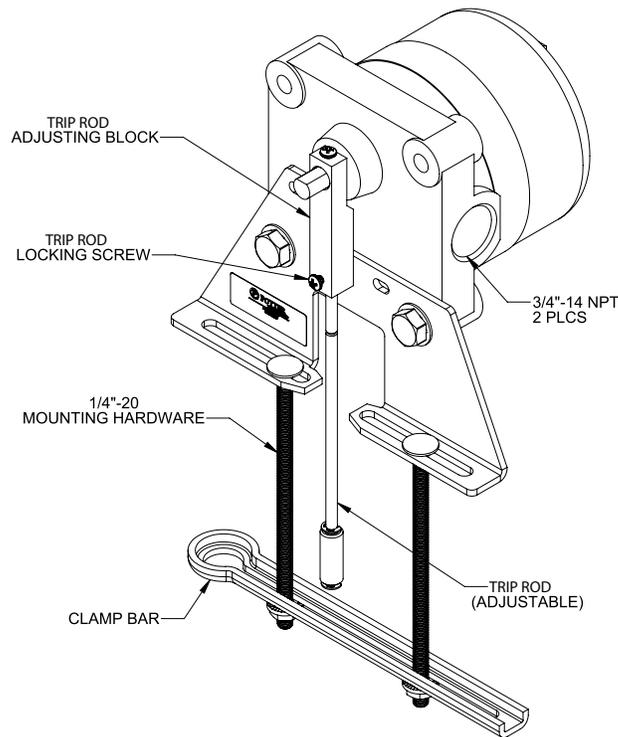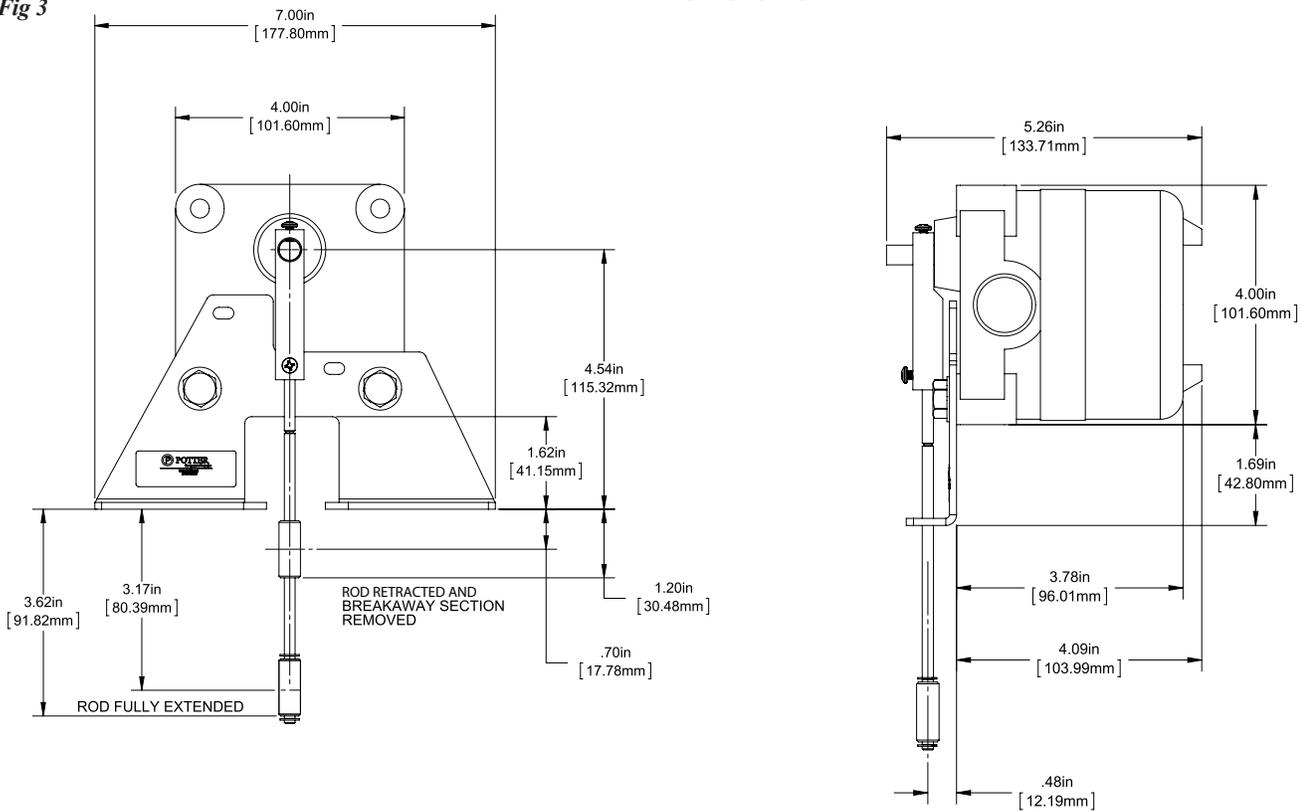


Breaking Excessive Rod Length

Fig 4



Switch Terminal Connections Clamping Plate Terminal

Fig 5

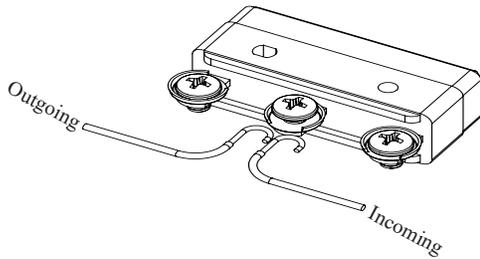


⚠ WARNING

An uninsulated section of a single conductor should not be looped around the terminal and serve as two separate connections. The wire must be severed, thereby providing supervision of the connection in the event that the wire become dislodged from under the terminal. Failure to sever the wire may render the device inoperable risking severe property damage and loss of life.

Do not strip wire beyond 3/8" of length or expose an uninsulated conductor beyond the edge of the terminal block. When using stranded wire, capture all strands under the clamping plate.

Typical Electrical Connections

Fig 6

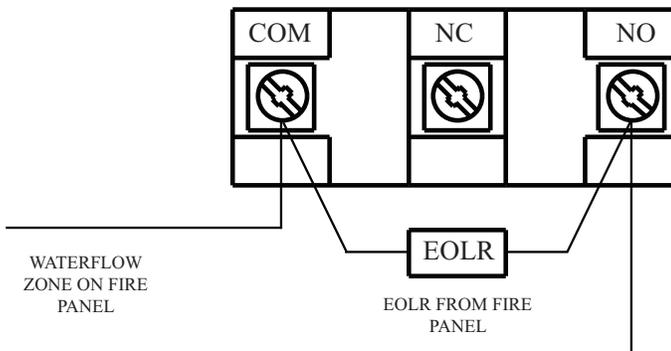

Ordering Information

Model	Description	Stock No.
OSYSU-EX-O	Outdoor Explosion Proof Outside Screw and Yoke Valve Supervisory Switch	1010121

Engineering Specifications: Explosion Proof supervisory switch for OS&Y Valves

Weatherproof and explosion proof valve supervisory switches shall be furnished and installed on all OS&Y type valves that can be used to shut off the flow of water to any portion of the fire sprinkler system, where indicated on the drawings and plans and as required by applicable local and national codes and standards. The switch enclosure shall be UL Listed and CSA Certified and NEMA 1, 3, 4, 4X, 6, 6P, 9 and 13 rated for hazardous locations classified as Class I, Division 1 and 2, groups C and D and Class II, Division 1 and 2, groups E, F and G and capable of being mounted in any position indoors or outdoors. The enclosure shall contain two 3/4 - 14 NPT threaded opening for conduit connection. The mounting bracket of the device shall be 316 stainless steel to resist corrosion and knurled to prevent slippage on the valve yoke. The device shall contain an adjustable length trip rod, the trip rod shall be held captive by a set screw accessible without removal of the cover. The switch contacts shall be rated at 15.0A, 125/250VAC and 0.5A, 125VDC. Outdoor Explosion Proof OS&Y Valve supervisory switch shall be model OSYSU-EX-O manufactured by Potter Electric Signal Company LLC

NOTICE

Supervisory switches have a normal service life of 10-15 years. However, the service life may be significantly reduced by local environmental conditions.