



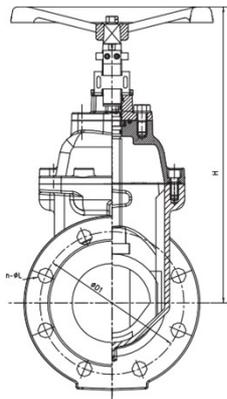

Gate Valves | Non-Rising Stem (NRS) | BS5163 | Flange | NRF5

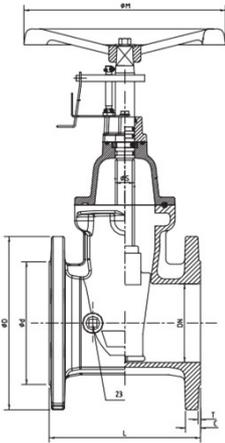

SPECIFICATIONS	
Sizes	2"/DN50, 2½"/DN65, 3"/DN80, 4"/DN100, 5"/DN125, 6"/DN150, 8"/DN200, 10"/DN250, 12"/DN300, 14"/DN350
Working Pressure	232 psi / 16bar
Working Temperature	0°C to 70°C (32°F to 158°F)
Seat type	Resilient wedge, EPDM encapsulated
Finish	Fusion bonded epoxy coated internal & external
Material (body)	Ductile iron
Connections	Flange diameter and thickness according to EN1092-2 PN16, ASME B16.1 CL125 or EN1092-2 PN10
Specifications	Design in accordance with BS 5163; Face to face dimension in accordance with EN 558-1, basic series 3
Supervision	Integral bracket allows monitoring of valve in open position using supervisory switch, P/N 828482. For monitoring closed position part number NRF-SB is required
Approvals	WRAS

Product Data & Part Numbers

Part Numbers			Nominal Pipe Size		PN	Dimensions mm								Weight (kg)
ANSI	PN10	PN16	DN	Inch		L	H	D	ØD1	Ød	C	T	n-d	
NRF5-0200W		NRF5-0200PNW	DN50	2"	10/16	178	282	165	125	99	19	3	4-Ø19	10.6
NRF5-0250W		NRF5-0250PNW	DN65	2½"	10/16	190	290	185	145	118	19	3	4-Ø19	12.6
NRF5-0300W		NRF5-0300PNW	DN80	3"	10/16	203	331	200	160	132	19	3	8-Ø19	16.7
NRF5-0400W		NRF5-0400PNW	DN100	4"	10/16	229	366	220	180	156	19	3	8-Ø19	21.3
NRF5-0500W		NRF5-0500PNW	DN125	5"	10/16	254	437	250	210	184	19	3	8-Ø19	38.4
		NRF5-0600W	DN150	6"	10/16	267	490	285	240	211	19	3	8-Ø23	42.5
NRF5-0800W	NRF5-0800PN10W	NRF5-0800PN16W	DN200	8"	10/16	292	560	340	295	266	20	3	8-Ø23	62.6
					16								12-Ø23	
NRF5-1000W	NRF5-1000PN10W	NRF5-1000PN16W	DN250	10"	10/16	330	706	405	350	319	22	3	12-Ø23	117.1
					16				355				12-Ø28	
NRF5-1200W	NRF5-1200PN10W	NRF5-1200PN16W	DN300	12"	10/16	356	802	460	400	370	24.5	4	12-Ø23	164.9
					16				410				12-Ø28	
NRF5-1400W	NRF5-1400PN10W	NRF5-1400PN16W	DN350*	14"	10/16	381	1005	520	460	429	26.5	4	16-Ø23	316.1
					16				470				16-Ø28	

Valve flange drilling (size and location of bolt holes and pitch circle diameter) allows mating with the following flange types :
 ANSI = ANSI B16.1 Class 125 PN10 = DIN 2501, BS 4504, EN 1092 - PN10 PN16 = DIN 2501, BS 4504, EN 1092 - PN16
 * 14"/DN350 is not WRAS approved

Note: This document contains basic product information only. For more information, contact your local VIKING Sales Representative. Certificates, test reports and approvals may be published in the OEM name. The contents of this publication are subject to change without prior notice. All rights reserved. Images are purely for illustration only. Fireking™ is a trademark of The Viking Corporation.

Trusted above all.

The Viking Corporation (far East) Pte. Ltd. | 69 Tuas View Square, Westlink Techpark, Singapore 637621 | vikingapac@vikingcorp.com






Gate Valves | Non-Rising Stem (NRS) | BS5163 | Flange | NRF5

Product Parts, Materials & Standard

Item	Description	Material	Specification
1	Valve body	Ductile iron	EN-GJS-450-10
2	Resilient wedge disc	Ductile iron	EN-GJS-450-10 & EPDM
3	Stem	Stainless steel	SS420
4	Bolt	Carbon steel	Zinc plated
5	Bonnet	Ductile iron	EN-GJS-450-10
6	O-ring	Nbr	Commercial
7	Gland	Ductile iron	EN-GJS-450-10
8	Position fixing spindle	Stainless steel	SS316
9	Limit plate	Stainless steel	SS316
10	Position fixing plate	Stainless steel	SS316
11	Handwheel	Ductile iron	EN-GJS-450-10
12	Bolt	Carbon steel	Zinc plated
13	Flat washer	Carbon steel	Zinc plated
14	Bolt	Carbon steel	Zinc plated
15	Fixed plate	Stainless steel	SS316
16	Ring wiper	Epdm	Commercial
17	Bolt	Carbon steel	Zinc plated
18	Flat washer	Carbon steel	Zinc plated
19	O-ring	Epdm	Commercial
20	Thrust washer	Brass	HPb59-1
21	Bonnet gasket	Epdm	Commercial
22	Wedge nut	Brass	HPb59-1
23	1/2" Plug	bronze	ASTM B584C83600
24	Switch bracket for NRF5 Valve - Part Number: NRF-SB		

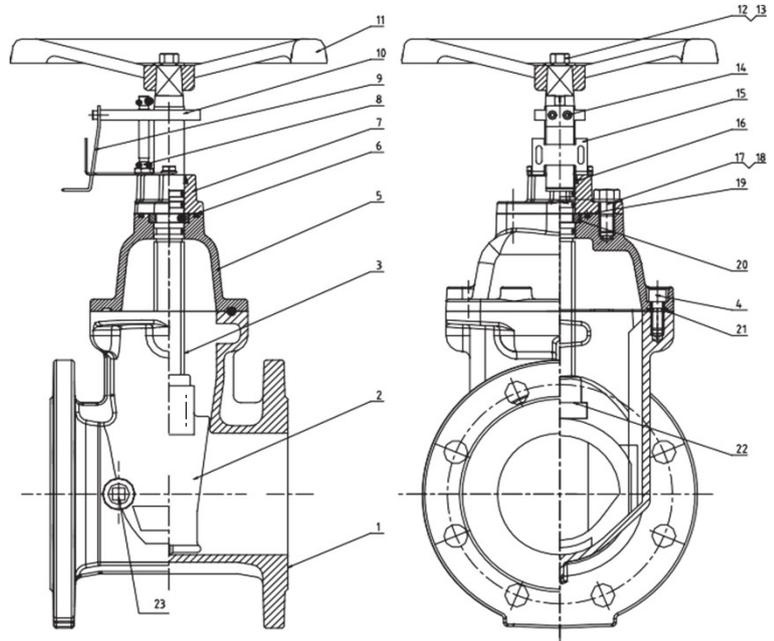

Installation | NRF5

1. Piping systems and valves should be thoroughly cleaned and free from ingress of foreign materials.
2. Visually inspect the valve seating and ports for cleanliness immediately prior to installation.
3. All valves should be independently supported against movement and stress from the connected piping system.
4. Ensure that the valve pressure rating is compatible with service conditions.
5. Operate the valve at least once from the open to closed position.
6. Gate valves are not suitable for throttling applications.
7. Gate valves should be installed in the vertical position on horizontal pipework and in the horizontal position on vertical pipework.

Operation | NRF5

Gate valves are manually operated multi-turn valves and are opened by a handwheel or other operating device, generally in a counter-clockwise direction and then closed clockwise.

Inspection & Maintenance | NRF5

Valves should be inspected periodically and should be cycled to prevent buildup of foreign materials in the piping system and valve body.

Closing torque for handwheel

Size	Closing Torque	
	Nm	lbf
DN50	27	19.9
DN65	38	28.0
DN80	65	47.9
DN100	80	59.0
DN125	100	73.8
DN150	125	92.2
DN200	160	118.0
DN250	240	177.0
DN300	300	221.3
DN350	306	225.7

Note: This document contains basic product information only. For more information, contact your local VIKING Sales Representative. Certificates, test reports and approvals may be published in the OEM name. The contents of this publication are subject to change without prior notice. All rights reserved. Images are purely for illustration only. Fireking™ is a trademark of The Viking Corporation.

Trusted above all.

The Viking Corporation (far East) Pte. Ltd. | 69 Tuas View Square, Westlink Techpark, Singapore 637621 | vikingapac@vikingcorp.com

